


NOTE: WATERSTOPS MUST BE FULLY ENCAPSULATED WITH CONCRETE A MIN OF 3" ON BOTH SIDES



NOTE: E.BASE 316 OVERLAP SHALL OCCUR A MIN. OF 2' FROM PILE OR MIN. OF 1" PAST THE EDGE OF THICKENED FOOTING, WHICHEVER IS GREATER

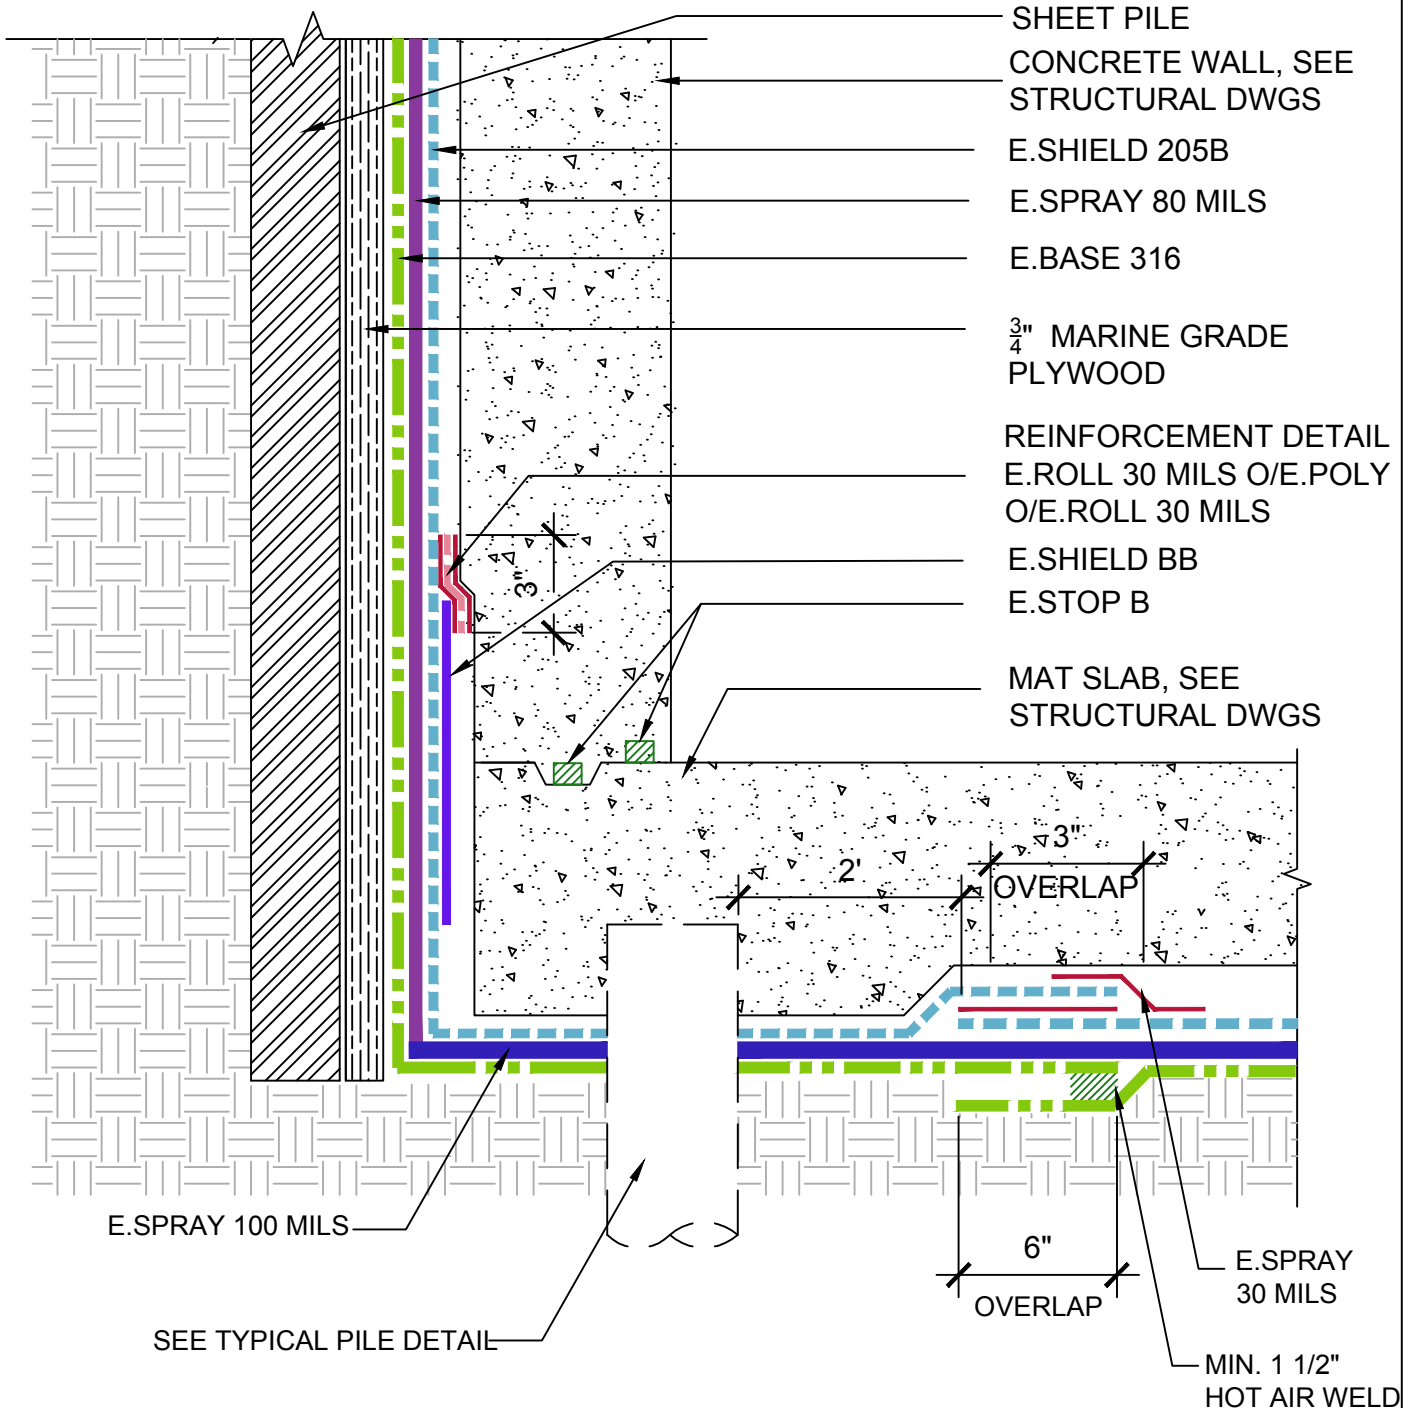

SYSTEM  
E.PROTECT+

OLD REFERENCE

NOT TO SCALE

THICKNESS OF EPRO PRODUCTS ARE ENLARGED FOR CLARITY

AS A SUPPLIER OF FINISHED PRODUCTS ONLY, EPRO SERVICES, INC. DOES NOT ASSUME RESPONSIBILITY FOR ERRORS IN DESIGN, ENGINEERING OR DIMENSIONS. THE PROJECT TEAM MUST VERIFY ALL DIMENSIONS AND SUITABILITY OF DETAILS. THE PRODUCTS LISTED ARE TRADEMARKS OF EPRO SERVICES, INC.

UNDERSLAB TRANSITION  
MAT SLAB TO SHEET PILE  
SHORING AND PILE FOUNDATION

REVISIONS

ISSUED DATE

DRAWING NO.

6.29.18

3.140.3.1